NANOOSE BAY WATER SERVICE AREA WATERLINES

REGIONAL DISTRICT OF NANAIMO

Legend

Bylaw No 867.08 - Nanoose Bay Water Service Area

3124 Building and Address

- Well
- <all other values>
- Air Relief Valve
- Booster Station
- Chamber
- Check Valve
- End Cap
- Flow Control
- Flush Out
- Future Hydrant
- Hydrant
- Meter
- NC Valve
- Pressure Reducer Valve
- Pumphouse
- Pumphouse/PRV
- Reservoir
- Treatment Plant
- Valve

Pipe Size, Material

- 100, AC
- 100, DI
- 100, PVC
- 150, AC
- 150, DI
- 150, PERMASTRAND
- 150, PVC
- 200, AC
- 200, AC Abandoned
- 200, DI
- 200, HDPE
- 200, PVC
- 250, DI
- 250, PVC
- 300, DI
- 400, DI
- 400, PVC
- 50, PVC
- 75, PVC

N

0 125 250 500 750 1,000 Meters
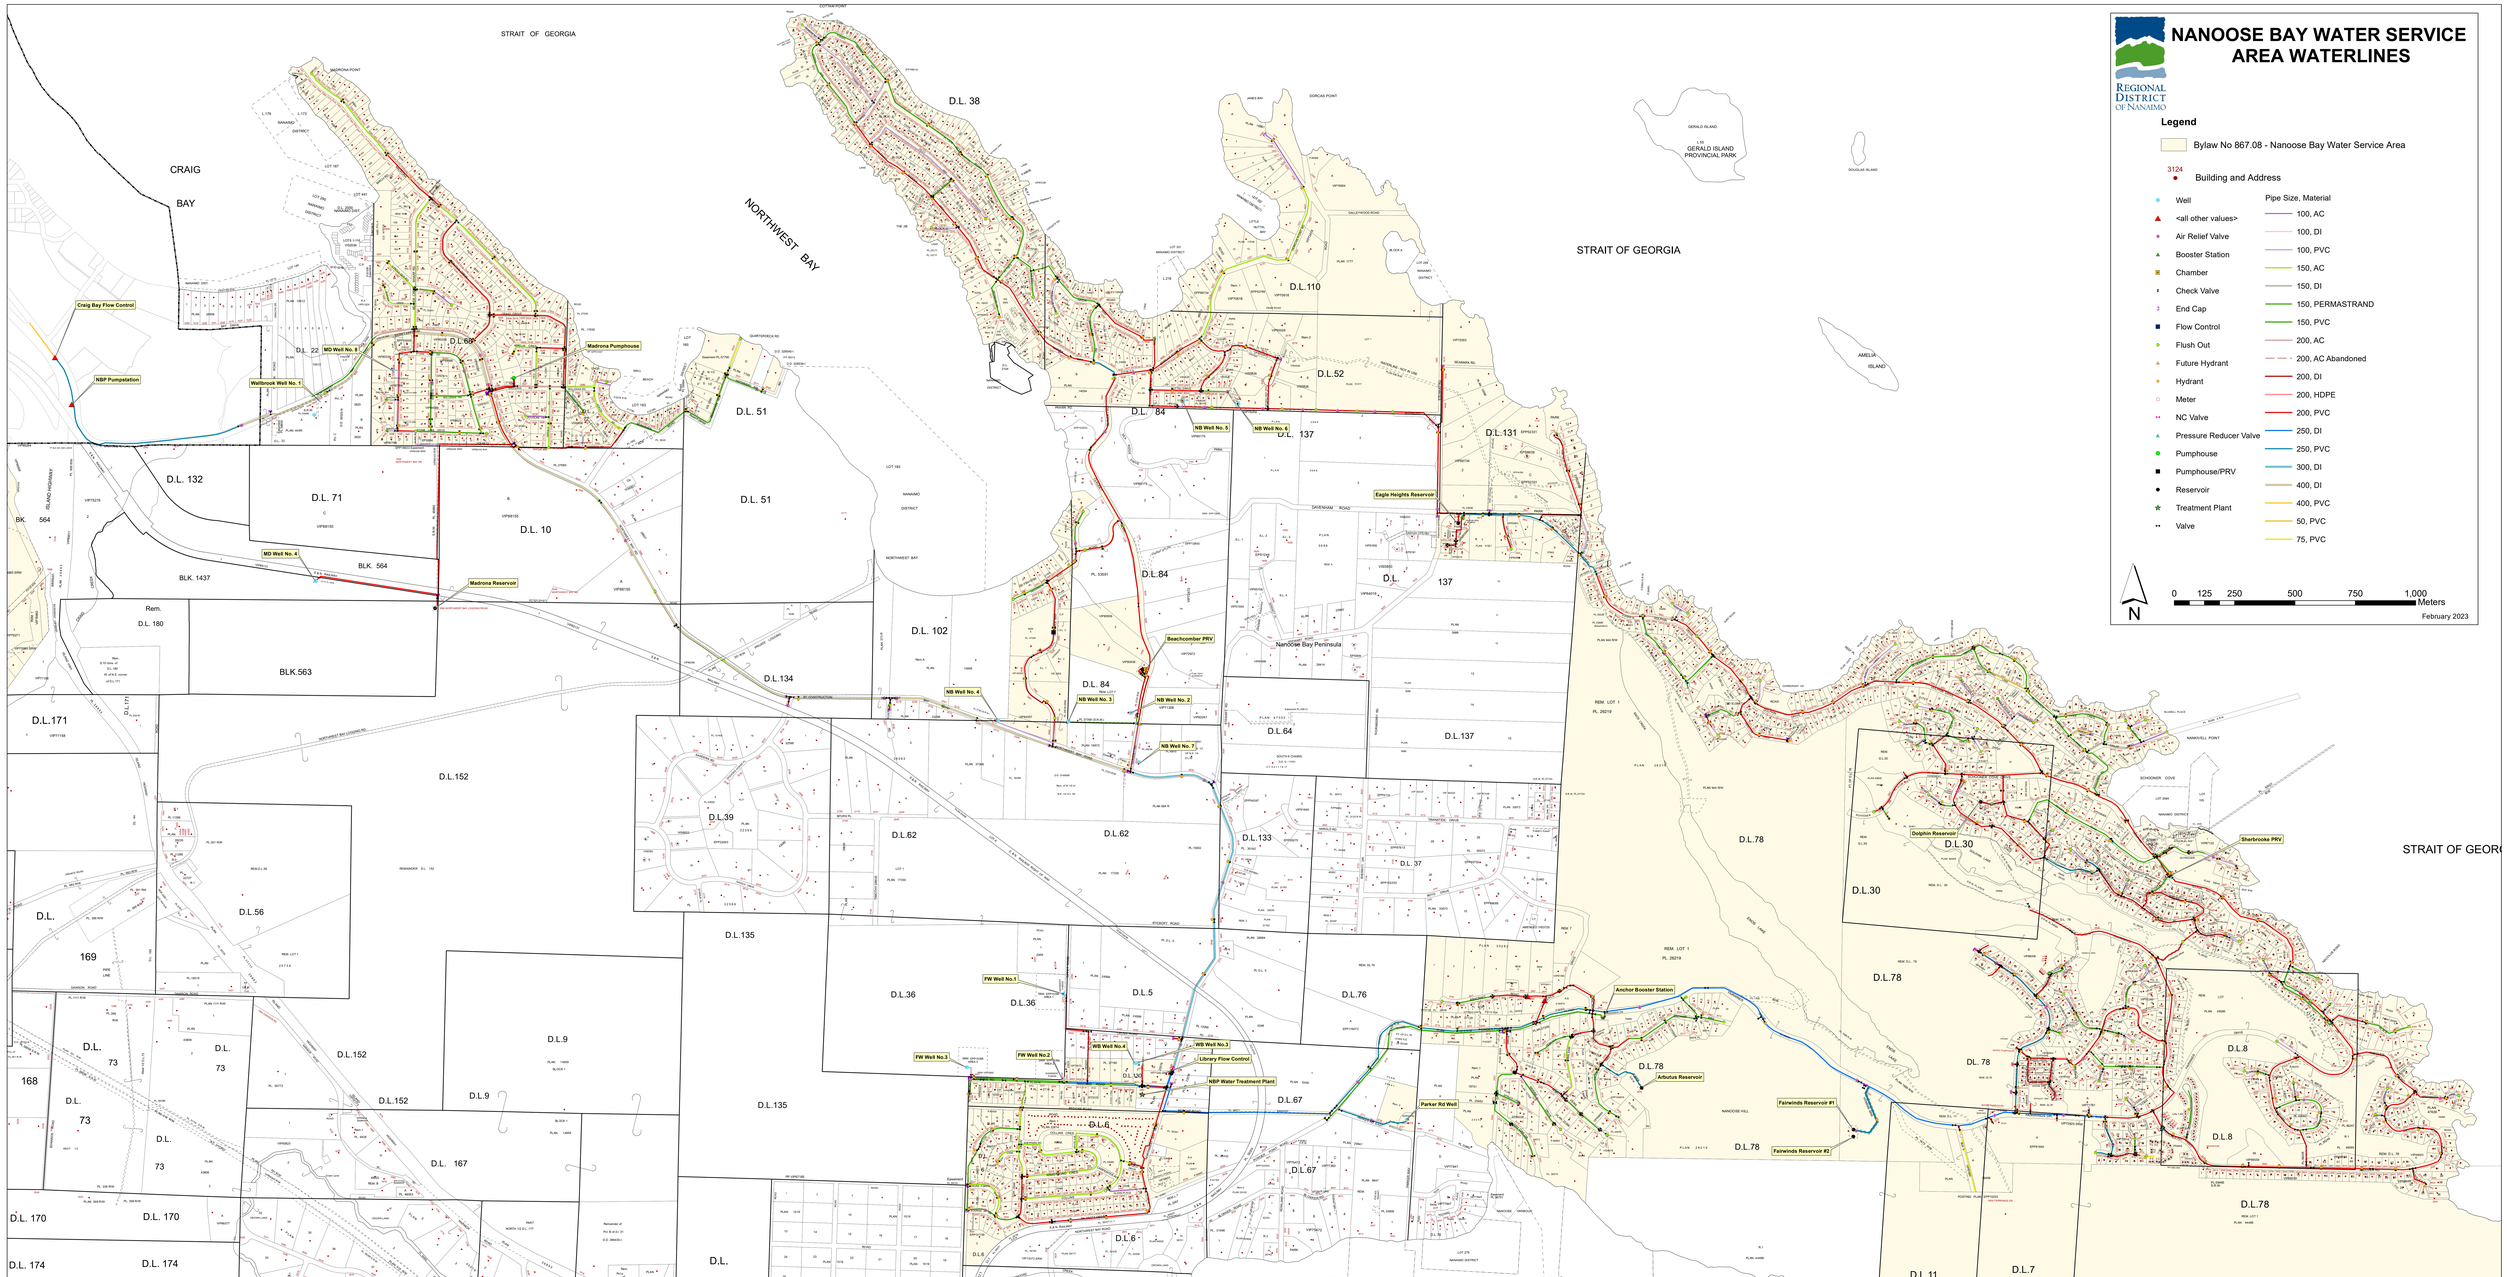
February 2023