


April 7, 2022

Madrona, Wall Beach Water Service Area – Low Water Pressure

A communication failure between the Madrona pumphouse and the Madrona reservoir caused homes in the Madrona, Wall Beach and Madrona Heights areas to experience very low water pressure at approximately 8:30 a.m. this morning, April 7, 2022. Crews turned on the well pumps manually and directed water from other pressure zones into the Madrona system. Service was completely restored by 10:15 a.m.

To receive water service alerts directly via email, sign up at rdn.bc.ca/subscribe. You can also subscribe to receive RDN service alerts via text, app and email via Voyent Alert at rdn.bc.ca/voyent-alert.

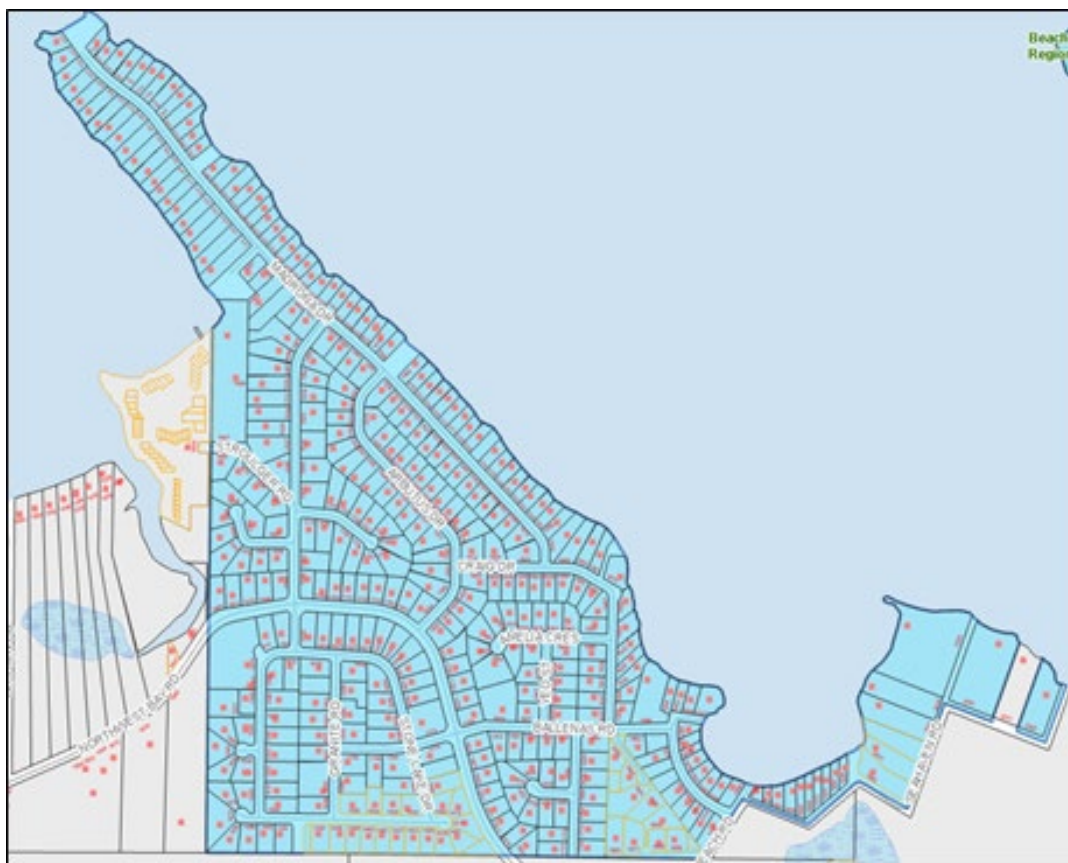


For more information, please contact:

Water Services

Regional District of Nanaimo

 250-390-6560 or 250-248-4914

 rcu@rdn.bc.ca

Get Involved RDN!